



CHECKLIST FOR STATIC PILE LOAD TEST SUPERVISION

**WORK INSTRUCTIONS FOR ENGINEERS**

Compiled by : \_\_\_\_\_ FCC \_\_\_\_\_

Checked by : \_\_\_\_\_ LSS \_\_\_\_\_

Approved by : \_\_\_\_\_ GSS \_\_\_\_\_



**OP-3-26. CHECKLIST FOR STATIC PILE LOAD TEST SUPERVISION**

**CHECKLIST FOR STATIC PILE LOAD TEST SUPERVISION**

**26.0 CHECKLIST FOR STATIC PILE LOAD TEST SUPERVISION**

**26.1. INTRODUCTION**

A checklist for supervision of static pile load test.

**26.2. 26.2 DESK STUDY**

Study the following Documents and Clarify with Project Engineer.


- 1) Method statement on Pile installation including driving rig and equipment.
- 2) Specifications for Materials and Testing (Reinforcement, Grade of concrete and Dimension including end plate and shoes).
- 3) Construction Drawings. (Shearby for Downdrag pile, Instrumentation Piles).

Review and Comment on the following Construction.

- 4) S.I. and surface profiles information (Borelogs & other investigation information).
- 5) Pile Installation Record, Installation Date and Testing Plate (Soil Setup).

**26.3. ON SITE SUPERVISION**

Refer to the attached self explanation checklist behind.

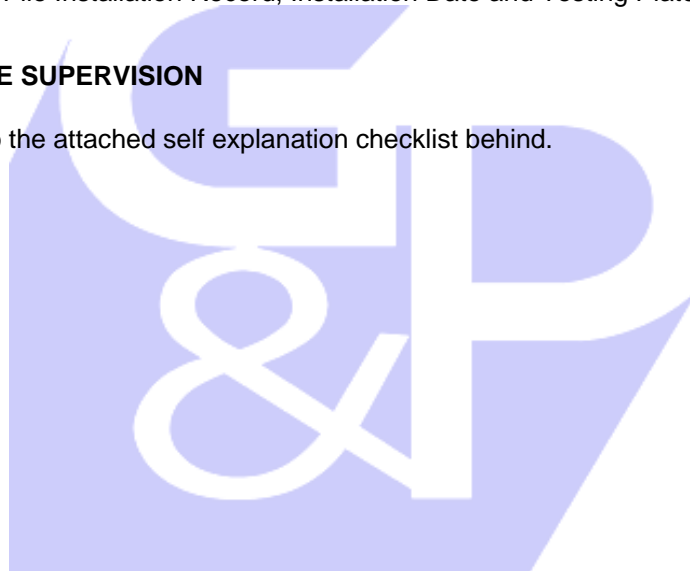

## CHECKLIST FOR STATIC PILE LOAD TEST SUPERVISION

No.	CHECKLIST ITEMS* *(see next page for explanatory notes on each point.)	CHECKED BY
		S.O.
<b>1.0</b>	<b>KENTLEDGE/REACTION FRAME SETUP</b>	
1.1	Kentledge weight (nos. of blocks)/ Reaction Piles (Structural & Geotechnical capacity)	
1.2	Kentledge/ Reaction Piles supports (arrangement and titling of ground support).	
1.3	Kentledge block arrangement/ Reaction Frame arrangement (safety)	
1.4	Independent Reference Beam (IRB) (distance, rigid, planting of IRB legs)	
1.5	Pile head preparations (smoothness, levelled tension connection)	
1.6	Bearing plate (no compressible material).	
1.7	Hydraulic Jack (calibration, serial no., technical specs, ram area)	
<b>2.0</b>	<b>LOAD MEASURING DEVICE</b>	
2.1	Load Cell (calibration, serial no., specs)	
2.2	Hydraulics Pressure Gauge (calibration, serial no., specs)	
<b>3.0</b>	<b>PILEHEAD MONITORING DEVICE</b>	
3.1	Dial Gauges (4 numbers and 2 numbers on Reaction Piles):	
	• Coincide diagonal distance	
	• Calibration	
	• Attachment to rigid IRB	
	• Initial base reading	
3.2	• Seating on glass plate	
	Optical Survey:	
	• Correction for IRB-ruler with equal distance	
	• TBM on fixed datum	
	• Pile head Movement-Ruler on pile.	
• Reaction Piles Movement-Ruler on pile.		
• Ruler arrangement (please tick):		
<input type="checkbox"/>	Increasing value - settlement	
<input type="checkbox"/>	Decreasing value - settlement	
<b>4.0</b>	<b>LOADING SEQUENCE</b>	
4.1	Follow loading sequence procedure	
4.2	Take reading every 15min:	
	1. Load measuring device	
	2. Dial gauges	
	3. Optical survey	
4.3	Check the minimum holding time and the rate of Pilehead movement: (0.25mm/hr)	
<b>5.0</b>	<b>RECORDS</b>	
5.1	Take and record readings before and after load increment/decrement and record all necessary info.	
5.2	Client and engineer representative to sign on field sheet record.	
<b>6.0</b>	<b>MISCELLANEOUS</b>	
	Ensure the following are provided on site:	
	• Stop watch and clock	
	• Levelling equipment.	
	• Lighting and torchlight for night measurement.	

## CHECKLIST FOR STATIC PILE LOAD TEST SUPERVISION

## Explanatory Notes:

Item	Explanation
<b>1.0</b>	<b>KENTLEDGE SETUP</b>
1.1	Estimate the weight by counting the number of blocks and multiplied by the weight of each block (~ 1.2 times test load) or check the Structural & Geotechnical capacities of the reaction piles.
1.2	Check the arrangement of primary and secondary girders and check to make sure no tilting of the ground support blocks and the whole kentledge block or Reaction Frame.
1.3	Check the kentledge blocks arrangement or Reaction Frame so that they are positioned in a orientation as not to endanger the safety of the personnel underneath the kentledge.
1.4	Ensure that there are 2 diagonally opposite points (one on each IRB) with equal distance from and coincide to the centre of test pile. Ensure that IRB is rigid in frame and must be firmly nailed to ground. Check support for IRB placed not less than 3x diameter or 2m, whichever is greater, from the centre of test pile.
1.5	Ensure that the pile head is smooth and levelled for the seating of steel bearing plate or sufficient Tension connection.
1.6	Ensure bearing plate used is metal and of no compressible material underneath it.
1.7	Check the serial number on the hydraulic jack with the calibration certificate and technical specifications (especially the ram area for load conversion).
<b>2.0</b>	<b>LOAD MEASURING DEVICE</b>
2.1	Check the serial number on the Load Cell with the calibration certificate and technical specifications. Ensure that the load cell is concentric with the test pile.
2.2	Check the serial number on the Hydraulics Pressure Gauge with the calibration certificate.
<b>3.0</b>	<b>PILE HEAD MOVEMENT MONITORING DEVICE</b>
3.1	<b>Coincide diagonal distance:</b> Four dial gauges attached to the IRB and with the needle seating on glass plates at the bearing plate on test pile head must be equal distance and coincide from the centre of test pile. <b>Calibration:</b> Check the serial number on the Load Cell with the calibration certificate, and technical specifications. <b>Attachment to rigid IRB:</b> The dial gauges must be rigidly fixed to the IRB. <b>Initial base reading:</b> Record the initial base reading on the dial gauges before loading the first load increment.
3.2	<b>Correction for IRB:</b> Ensure two rulers on the IRB, which must be diagonally opposite (one on each IRB), equal distance from and coincide to the centre of test pile. <b>TBM on fixed datum:</b> Ensure that the TBM are located on firm and secure datum. <b>Pile Head Movement:</b> Take optical readings of the pile head movement and the IRB points (2). <b>Reaction Pile Movement:</b> Take optical readings of the pile head movement. <b>Ruler Arrangement:</b> Please put rulers with clear readings (in mm) on each point on the IRB and indicate which option used: <input type="checkbox"/> Increasing value – indicates settlement. <input type="checkbox"/> Decreasing value – indicates settlement.
<b>4.0</b>	<b>LOADING SEQUENCE</b>
4.1	Follow the loading sequence as in the specifications and a copy shall be stick on the Jack for reference.
4.2	Take the readings at every 15min of the dial gauges, optical survey of the IRB and the load measuring device (load cell + pressure gauge)
4.3	Check the rate of settlement (0.25mm/60 min) and the minimum holding time, whichever is greater.
<b>5.0</b>	<b>RECORDS</b>
5.1	Record all the necessary information as in the specification about the pile and test setup details. Immediately record down the readings on the field record sheet after taking the readings, which includes before and after each load increment/decrement.
5.2	After the static load test is completed or abandoned, the client and the engineer representative are to sign on the field record sheet.
6.0	MISC: Ensure that stopwatch for time keeping and levelling equipment for optical measurement is provided sufficiently.